




\$62,766

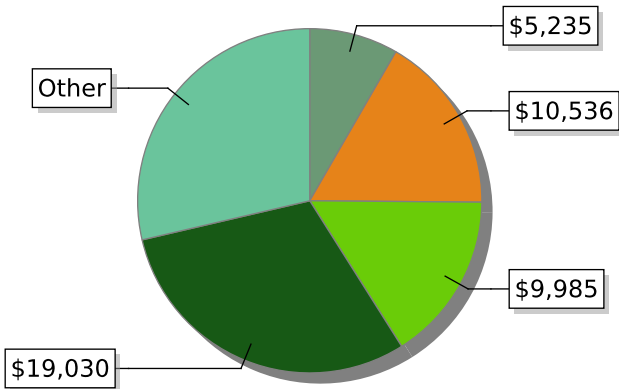


- 2625 Draper - Grant Alternative PS
- Collège catholique Franco-Ouest, 411 Seyton
- Collège catholique Samuel-Genest
- Franco-Citi, 623 Smyth
- Cumulation of all other sites

\*\* This chart shows sites with the highest production



\$137

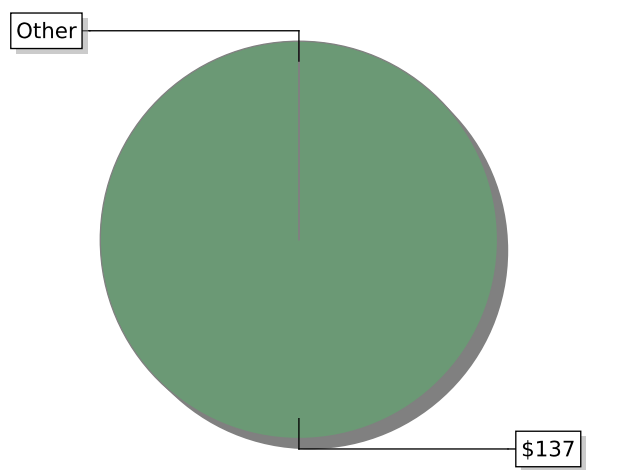

- École Élémentaire catholique Jean-Robert-Gauthier
- Cumulation of all other sites

\*\*This chart shows sites with largest loss

## Executive

Overall losses are higher than stated because a number of the underperforming systems only have a single inverter and MPPT level data isn't available to calculate losses relative to other inverters or MPPTs. A well functioning system appears to generate about 120kWh/DC kw in May. Given the large number of systems the performance is quite good.

### 2129 Arch - Arch Street PS

Central 100kW inverter - Appears to be performing at about 80% relative to 2015 in peak summer months. Likely strings out.

### 3810 Sixth - Blossom Park PS

Central 50kW inverter - Appears to be performing at about 90% relative to 2021. Likely strings out.

### École Élémentaire catholique Alain-Fortin

Comms down between Jan to July 2024 but appears to have been producing

### École Élémentaire catholique Arc-en-ciel

Inverter appears to have been down between March 16th and May 31st

### École Élémentaire catholique Élisabeth-Bruyère

Lost 50% of production suddenly on August 13th 2024 so probably strings out. Losses are approximately \$3,200/yr

### École Élémentaire catholique Jean-Robert-Gauthier

Appears that a string was disconnected on Inv #2 Oct 6th 2016 after the inverter shut down twice for a few days. Losses since likely \$7,000

### Saint-Jean-Paul II

Inverter was down between May 25th and May 30th but has been quite reliable since then

### Terre-des-Jeunes

Inverter had underperformance issues that started in 2023 and would shutdown and underperform. Appear to have been resolved mid May 2024

<i>Site</i>	<i>Click for Portal</i>	<i>DC Size</i>	<i>Revenue</i>	<i>Production</i>		<i>Losses</i>	
2129 Arch - Arch Street PS		68kW	\$4,588	6,435kWh	95kWh/kW	\$0	0%
2625 Draper - Grant Alternative PS		57kW	\$5,235	7,342kWh	129kWh/kW	\$0	0%
3810 Sixth - Blossom Park PS		65kW	\$4,539	6,366kWh	98kWh/kW	\$0	0%
55 Mann - Viscount Alexander PS		39kW	\$2,780	3,899kWh	101kWh/kW	\$0	0%
Collège catholique Franco-Ouest, 411 Seyton		130kW	\$10,536	14,777kWh	114kWh/kW	\$0	0%
Collège catholique Samuel-Genest		96kW	\$9,985	12,450kWh	130kWh/kW	\$0	0%
École Élémentaire catholique Alain-Fortin		10kW	\$0	0kWh	0kWh/kW	\$0	0%
École Élémentaire catholique Arc-en-ciel		10kW	\$7	18kWh	2kWh/kW	\$0	0%
École Élémentaire catholique Élisabeth-Bruyère		10kW	\$349	635kWh	64kWh/kW	\$0	0%
École Élémentaire catholique Jean-Robert-Gauthier		24kW	\$929	2,694kWh	112kWh/kW	\$137	13%
École Élémentaire catholique l'étoile-de-l'Est		10kW	\$652	1,187kWh	119kWh/kW	\$0	0%
École Élémentaire catholique La Vérendrye		10kW	\$657	1,197kWh	120kWh/kW	\$0	0%
École Élémentaire catholique Montfort		10kW	\$649	1,183kWh	118kWh/kW	\$0	0%
École publique de la Découverte		11kW	\$1,028	1,281kWh	116kWh/kW	\$0	0%
Franco-Citi, 623 Smyth		231kW	\$19,030	26,690kWh	116kWh/kW	\$0	0%
George-Etienne-Cartier		10kW	\$836	1,172kWh	117kWh/kW	\$0	0%
Saint-Jean-Paul II		10kW	\$500	910kWh	91kWh/kW	\$0	0%
Terre-des-Jeunes		10kW	\$466	849kWh	85kWh/kW	\$0	0%
<b>Total</b>			<b>\$62,766</b>	<b>89,086kWh</b>		<b>\$137</b>	<b>0.2%</b>