



\$


\$48,645

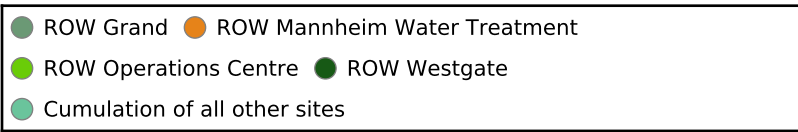

** This chart shows sites with the highest production

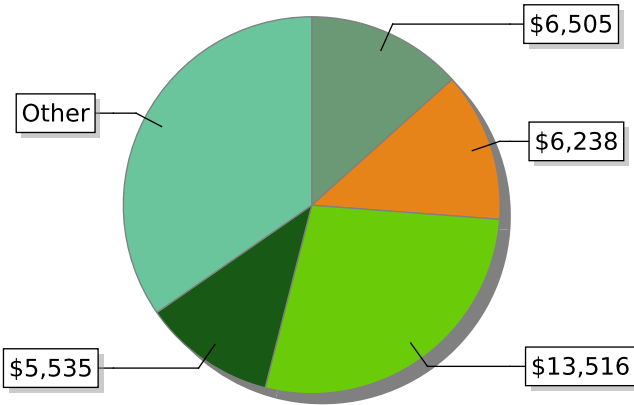

\$8,342

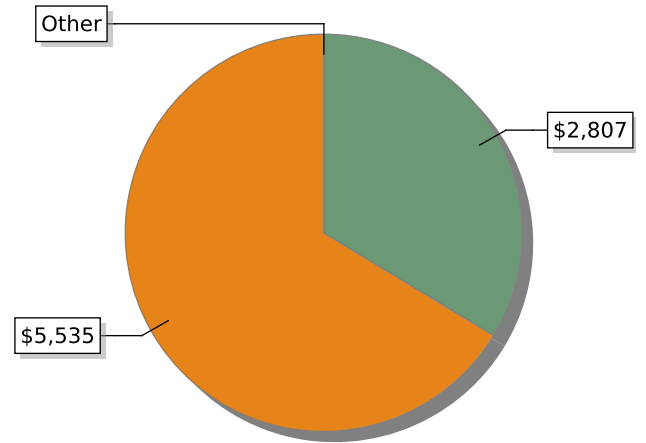

**This chart shows sites with largest loss

Executive

The main loss is due to Westgate Inverter #1 which has been down since November 10, 2019. Inverter #2 was down from Feb 4, 2021 until September 23rd 2021. Total losses since 2019 are approaching \$200,000
 ROW Operations Centre - Inverters #1,2 are underperforming by 50% since a 5 day site outage on July 3rd.
 Losses don't include apparent site outage from August 23rd to Sept 2
 ROW Beechwood - No data since August 2nd
 ROW Ottawa Reservoir - No data since April 24th

Site	Revenue	Production (kWh)	Losses	Loss
ROW Beechwood	\$22	28	\$0	0%
ROW Bishop	\$4,699	6,590	\$0	0%
ROW Church	\$1,025	1,277	\$0	0%
ROW College	\$977	1,219	\$0	0%
ROW Concession	\$1,965	2,755	\$0	0%
ROW Grand	\$6,505	9,124	\$0	0%
ROW Lorraine	\$2,358	3,307	\$0	0%
ROW Manitou Reservoir	\$3,760	5,273	\$0	0%

<i>Site</i>	<i>Revenue</i>	<i>Production (kWh)</i>	<i>Losses</i>	<i>Loss</i>
ROW Mannheim Water Treatment	\$6,238	8,749	\$0	0%
ROW Mulberry	\$1,040	1,297	\$0	0%
ROW Operations Centre	\$13,516	18,956	\$2,807	17%
ROW Ottawa Reservoir	\$0	0	\$0	0%
ROW Westgate	\$5,535	6,902	\$5,535	50%
ROW Wilson	\$1,006	1,254	\$0	0%
ROW WRPS	\$0	0	\$0	0%
ROW_GRT	\$0	0	\$0	0%
Total	\$48,645	66,732	\$8,342	14.6%